3" AND LARGER

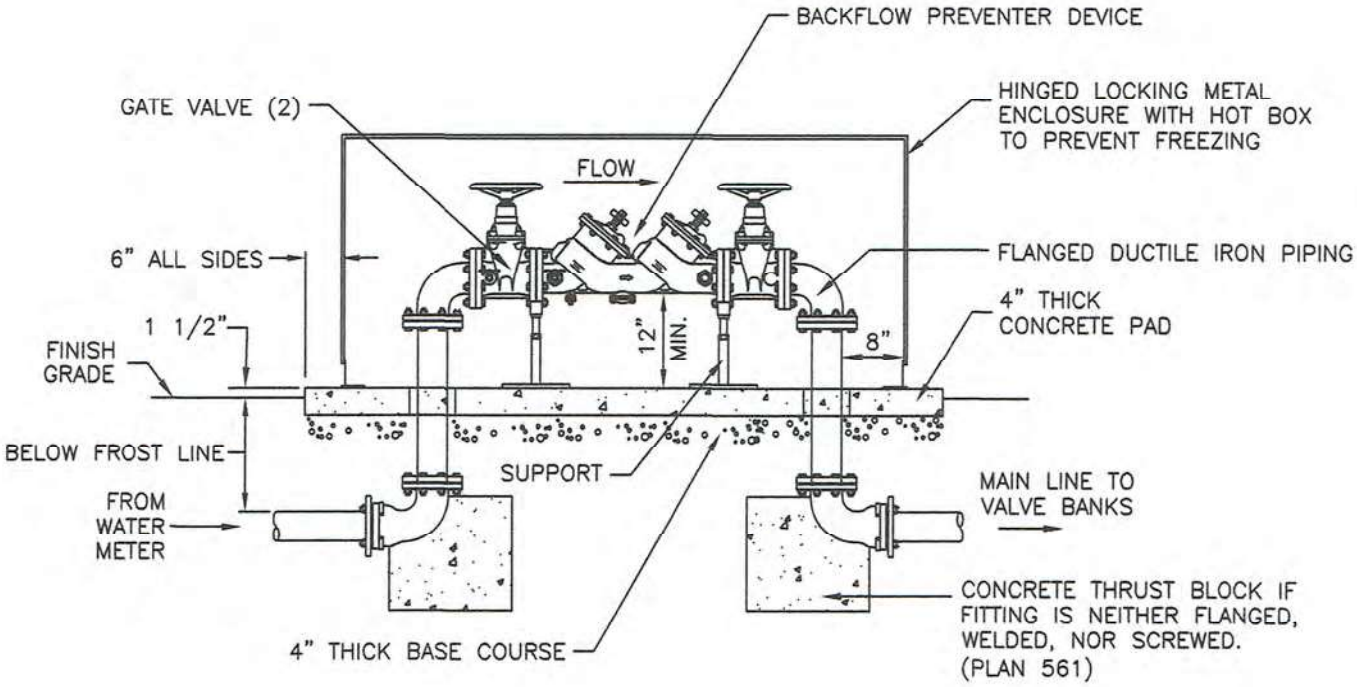
BACKFLOW PREVENTER DEVICE
GATE VALVE (2)
HINGED LOCKING METAL ENCLOSURE WITH HOT BOX TO PREVENT FREEZING
FLOW
6" ALL SIDES
FLANGED DUCTILE IRON PIPING
4" THICK CONCRETE PAD
1 1/2"
12" MIN.
8"
FINISH GRADE
BELOW FROST LINE
SUPPORT
FROM WATER METER
MAIN LINE TO VALVE BANKS
CONCRETE THRUST BLOCK IF FITTING IS NEITHER FLANGED, WELDED, NOR SCREWED. (PLAN 561)
4" THICK BASE COURSE